

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106


1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400

TEST REPORT

Client : The Mat Group
9-11 Shearson Cres,
Mentone VIC 3194

Test Number : 23-000889
Issue Date : 21/03/2023
Print Date : 21/03/2023
Order Number : awta1232rg

Sample Description Clients Ref : "Aluminium Architectural Matting"
Entrance Matting
Colour : Silver and Charcoal
End Use : Entrance matting
Nominal Composition : Aluminium, PVC backed Polypropylene
Nominal Thickness : 12mm

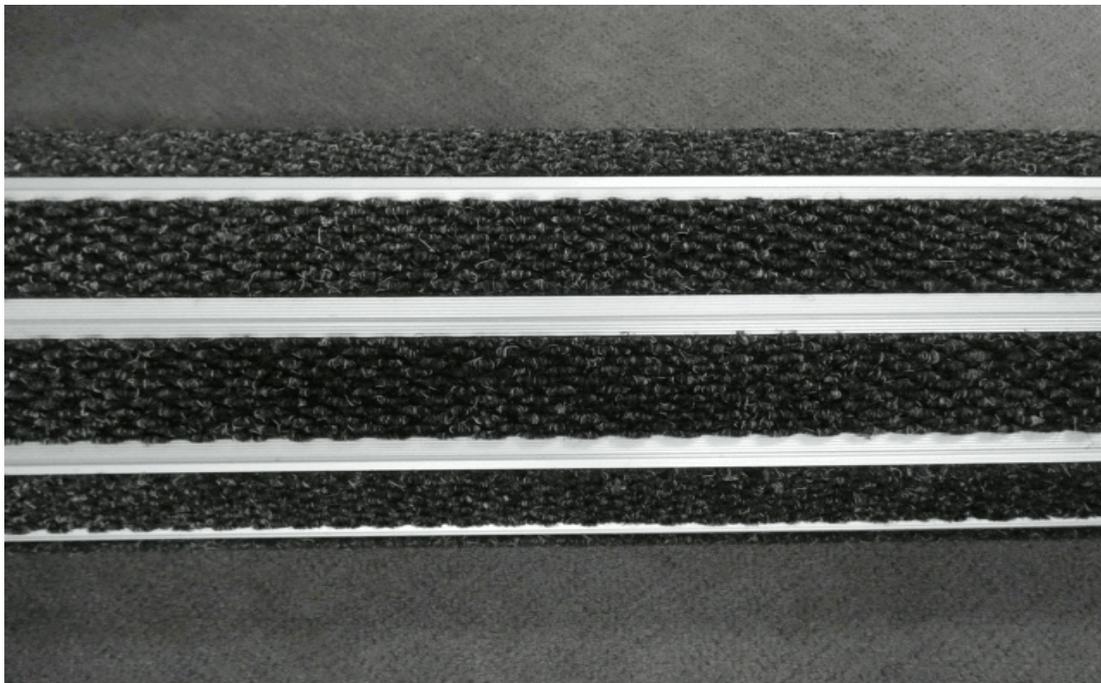

291394

63379

Page 1 of 2

© Australian Wool Testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing
Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400

TEST REPORT

Client : The Mat Group
9-11 Shearson Cres,
Mentone VIC 3194

Test Number : 23-000889
Issue Date : 21/03/2023
Print Date : 21/03/2023
Order Number : awta1232rg

AS 4586-2013
Appendix A

Slip Resistance Classification of new Pedestrian Surface Materials
Wet Pendulum Test Method

Date of Testing	20/03/2023					
Test Temperature (20±5degC)	22 °C					
Sample Preparation	Sample washed with pH neutral detergent then dried					
Test Direction	Length					
Fixed/Unfixed	Unfixed					
Slider No 96 Batch No	15					
Length	1	2	3	4	5	SRV
British Pendulum Number	55	55	55	55	56	55
Classification	P5					

Equipment: Cooper Pendulum Skid Tester Serial No: 1433-01 Calibrated 21/09/2021
Slider prepared using P400 and 3µm lapping film.

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance and wear on their slip resistance be checked.

Modification:

Due to the configuration of sample supplied the full length of slider was not in full contact with the sample. (Approx 20mm gap) Length of slider: 75mm
Results should be used for guidance purposes only

291394

63379

Page 2 of 2

© Australian Wool Testing Authority Ltd
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing
Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



Chris Campbell

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)
MANAGING DIRECTOR